


# Grease Interceptor Diagram

Influent(Inlet)

Effluent(Outlet)

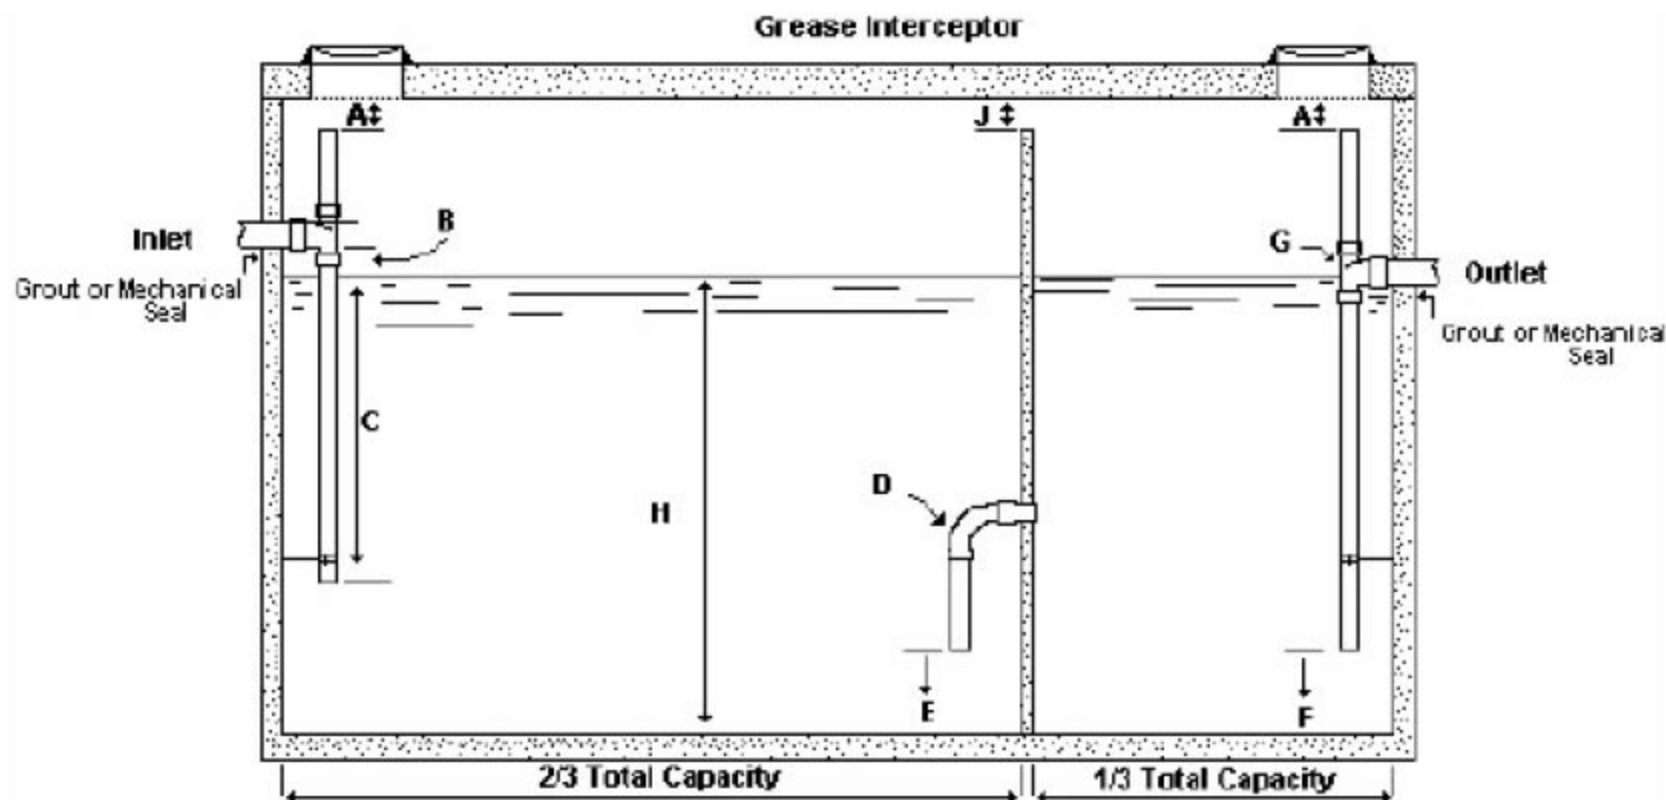

- A.) Minimum 6", but not less than pipe diameter.
- B.) Inlet pipe invert to be 2 1/2" above liquid surface.
- C.) Inlet pipe to terminate 2/3 depth of water level.
- D.) 90 degree Sweep, minimum size - 6".
- E.) 12" from floor to end of sweep.
- F.) 12" from floor to end of outlet pipe.
- G.) Outlet pipe no smaller than inlet pipe, minimum - 4".
- H.) Minimum depth of liquid capacity - 42".
- J.) Maximum distance from ceiling - 6".